


Private Drinking Water Well Sampling Results Through December 2021

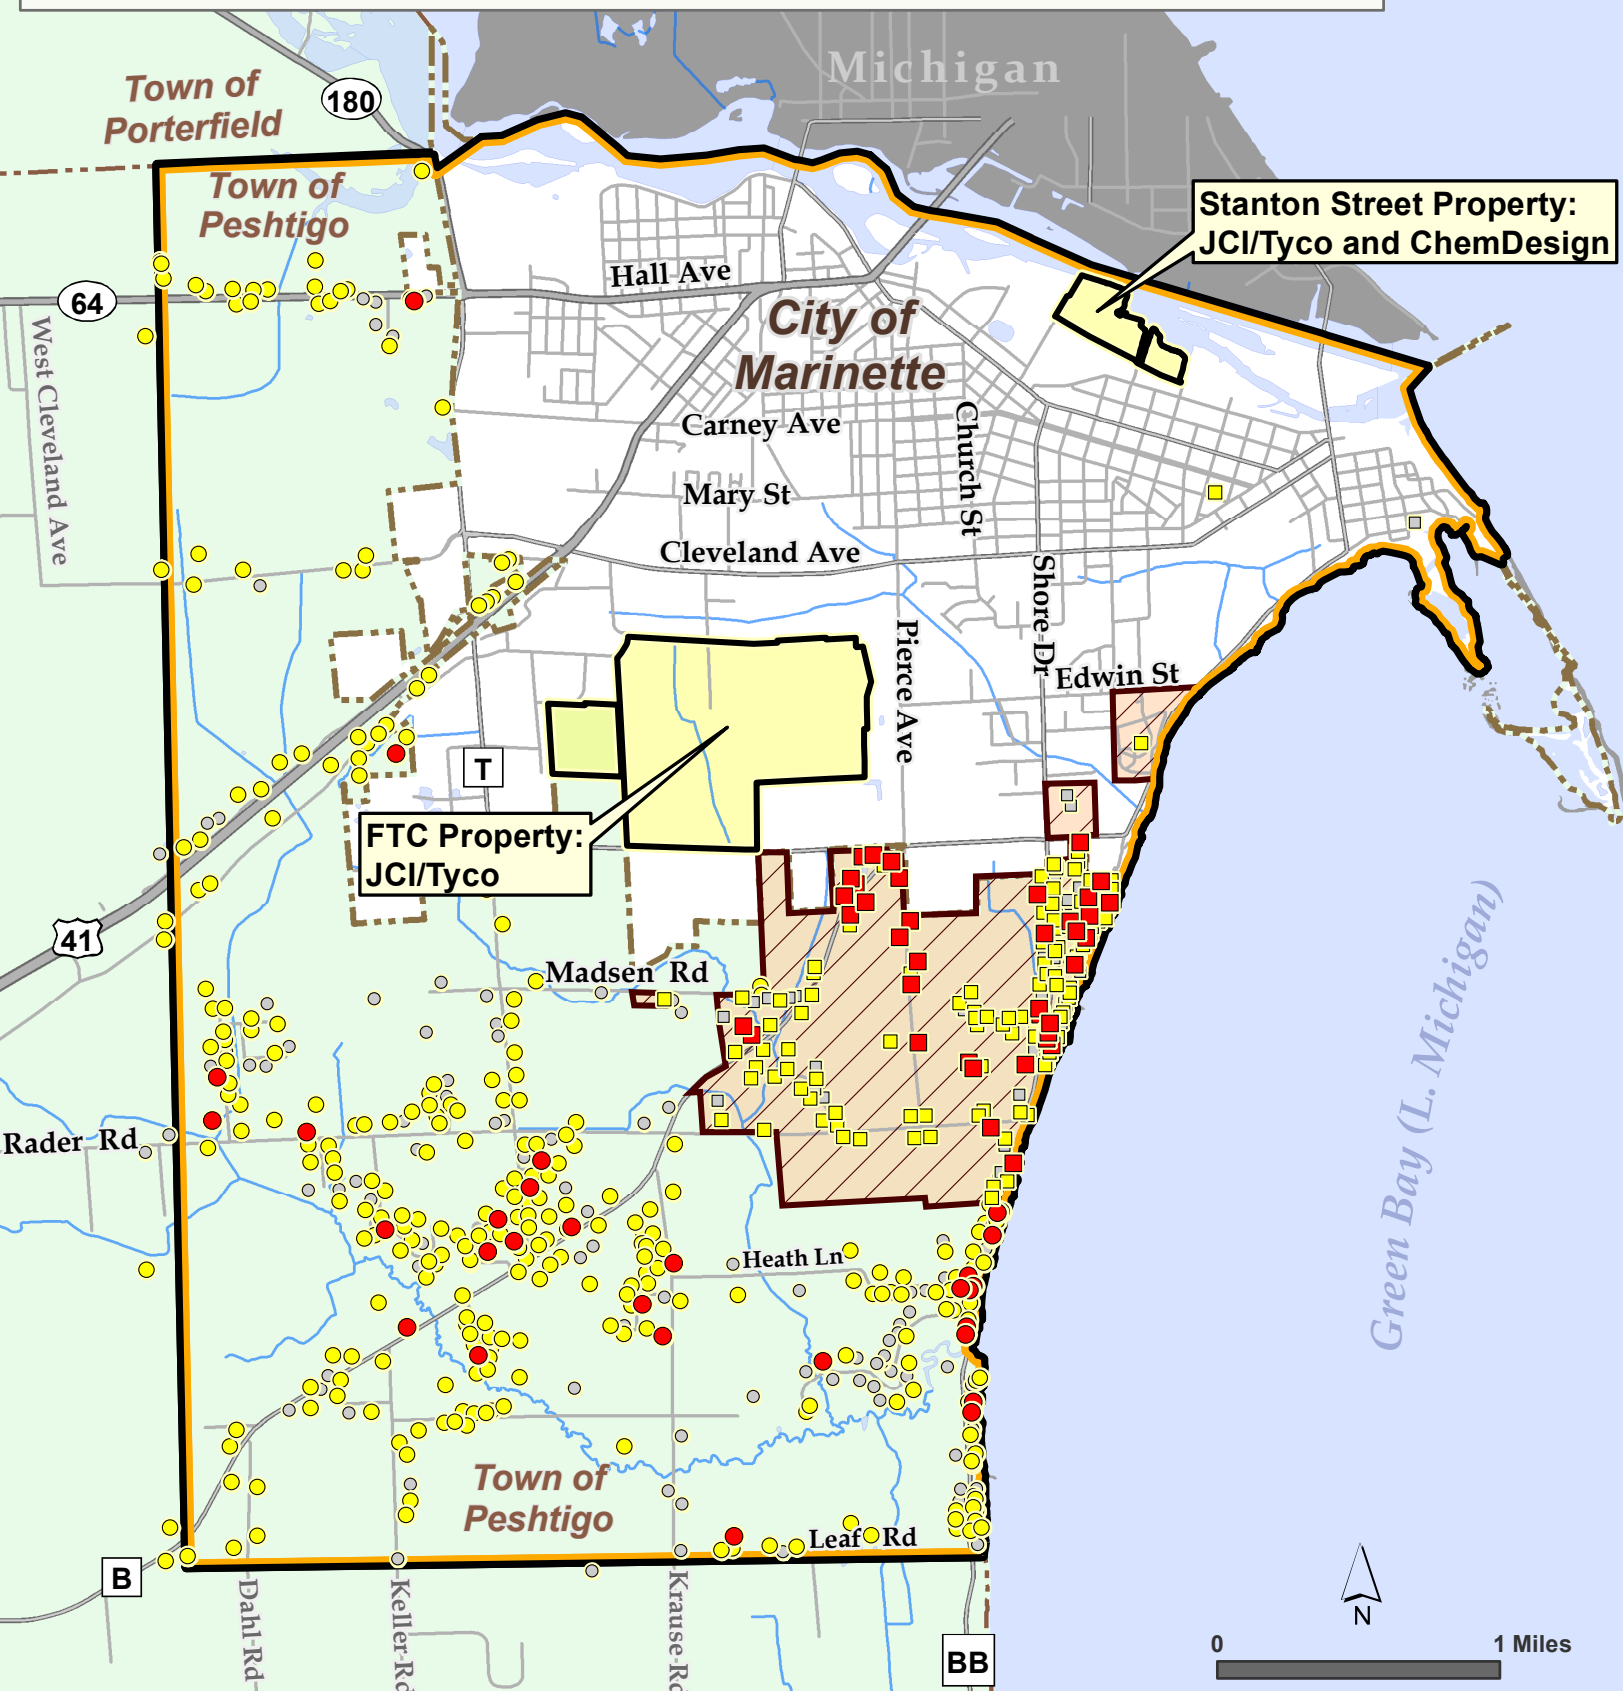

Site Investigation Area

JCI/Tyco Potable Well Sampling Area

Sampled by JCI/Tyco

Sampled by DNR

Private Drinking Water Well Results

PFAS not detected

PFAS < Recommended Enforcement Standards

PFAS \geq Recommended Enforcement Standards and/or Hazard Index of ≥ 1

Remediation & Redevelopment Program
Wisconsin Department of Natural Resources



0 1 Miles

